
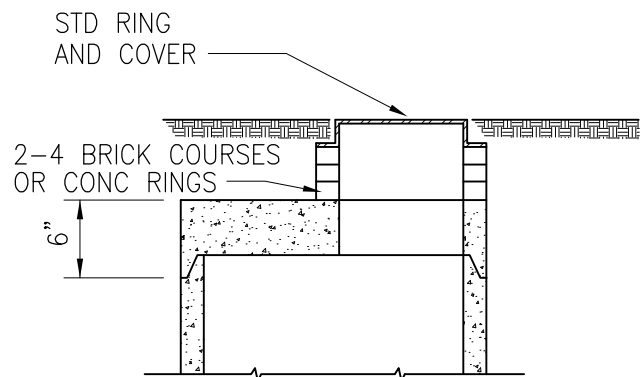



ELEVATION

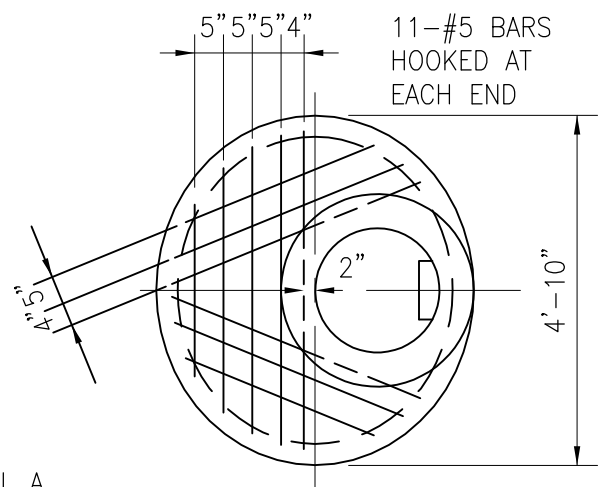

ALTERNATE FLAT LID

NOTE:

1. STEPS SHALL BE LOCATED ABOVE THE EXIT PIPE IN A STRAIGHT LINE, 12" ON CENTER (O.C.) VERTICALLY.
2. 60" DIA. MANHOLES SHALL HAVE A 30" STANDARD RING AND COVER, J-MARK NO. J-1361 OR APPROVED EQUAL.
3. 48" DIA. MANHOLES SHALL HAVE A 24" STANDARD RING AND COVER, J-MARK NO. J-1161 OR APPROVED EQUAL.
4. MORTAR SHALL COVER THE LEVELING COURSES AND RING TO WITHIN 1" FROM THE SURFACE, AND SHALL BE USED ON THE INSIDE OF THE BARREL AT THE JOINTS.
5. ALL MANHOLES IN EXCESS OF 20' IN DEPTH SHALL HAVE AN INTERMEDIATE GRATING LOCATED AT THE CENTER OF THE DEPTH.
6. THE WORD "SEWER" SHALL BE BOLDLY CAST ON ALL COVERS.



FLEXIBLE PLASTIC
JOINT MATERIAL
(K.T. SNYDER
"RAM-NEK" OR
APPROVED EQUAL)

DETAIL A



STANDARDS &
SPECIFICATIONS

REVISED:

**STANDARD
MANHOLE**

DATE:

DRAWING NO. 300-02